



技术咨询和询价：010-68940148

康高特-SONEL S VLF series High Voltage Insulation Testers

**Evaluate the condition of cables  
using VLF or DC voltage**

**Sonel®** experience and reliability

## Features


- Extremely compact high-power VLF test device
- Easily portable for 1-2 people
- Simple operation: menu-assisted control with industrial class OLED display
- Fully automatic test sequence
- Integrated timer 1-300 min with automatic tripping
- Integrated breakdown detection
- Integrated fault time detection
- Voltage measurement direct at HV output
- Protective ground connection
- High voltage start key interlock
- Protective circuit / indication in accord. with EN 50191
- Leakage current measurement during VLF test



## Overview

The compact, robust and portable S VLF cable test sets are used for testing of medium voltage cables in accordance to the standards IEEE400, IEC 60502-2, CENELEC HD 620 & 621 and DIN VDE 0276/620 & 621. The test is carried out with a low strain practice with VLF (very low frequency) test voltage at 0.1 Hz frequency.

VLF test enables detection of damages of the insulation within shortest test time. The S VLF series device can test cables with extruded insulation (XLPE-, PE-, EPR-insulation) as well as cables with paper-oil insulation (PILC). Cable sheath testing with direct voltage is also possible.

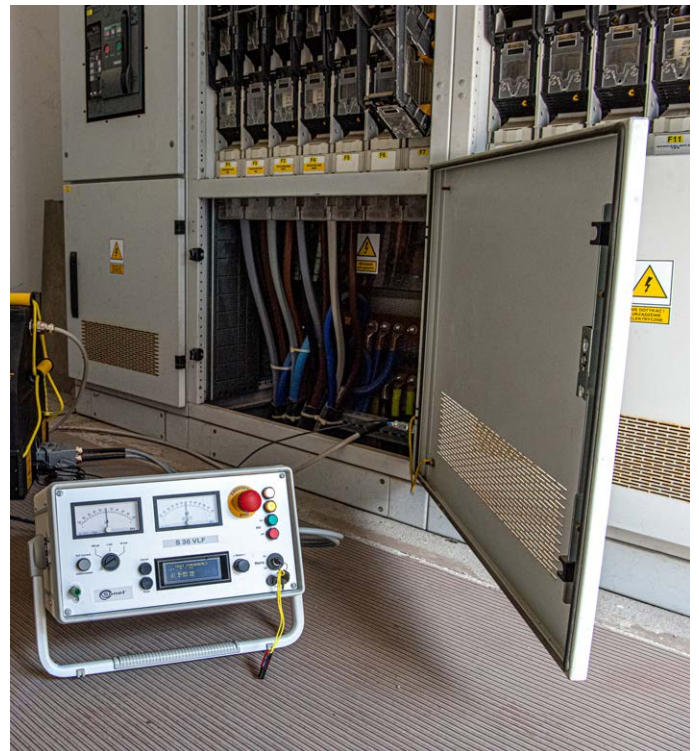

## Optional features

- Data logging (USB stick) for VLF test sets
- Frequency extension: 0.05 + 0.02 Hz
- Customized test cables
- Transport case



# Technical specification

		S-24 VLF	S-36 VLF	S-44 VLF		S-57 VLF
Index		WMGBS24VLF	WMGBS36VLF	WMGBS44VLF	WMPAS44VLF	WMGBS57VLF
Power supply		230 V (±10%) 10 A, 50/60 Hz	230 V (±10%) 10 A, 50/60 Hz	230 V (±10%) 10 A, 50/60 Hz	110 V (100 V...127 V) 15 A, 50/60 Hz	230 V (±10%) 10 A, 50/60 Hz
Output voltage		0...24 kV <sub>RMS</sub> VLF 0.1 Hz (option: 0.05 Hz + 0.02 Hz) ± 0...34 kV DC	0...36 kV <sub>RMS</sub> VLF 0.1 Hz (option: 0.05 Hz + 0.02 Hz) ± 0...52 kV DC	0...44 kV <sub>RMS</sub> VLF 0.1 Hz (option: 0.05 Hz + 0.02 Hz) ± 0...62 kV DC	0...44 kV <sub>RMS</sub> VLF 0.1 Hz (option: 0.05 Hz + 0.02 Hz) ± 0...62 kV DC	0...57 kV <sub>RMS</sub> VLF 0.1 Hz (option: 0.05 Hz + 0.02 Hz) ± 0...62 kV DC
Voltage waveshape	VLF	similar sine-wave, symmetrical, with True RMS measurement				
	DC	direct voltage, negative and positive polarity				
Overcurrent trip (DC)		10 mA				
Max. testable cable length, max. capacitance (VLF)		up to 60 km (15 µF at 24 kV <sub>RMS</sub> * 0.02 Hz)*	up to 60 km (15 µF at 18 kV <sub>RMS</sub> * 0.02 Hz)*	up to 60 km (15.0 µF at 18 kV <sub>RMS</sub> * 0.02 Hz)*	up to 60 km (15.0 µF at 6 kV <sub>RMS</sub> * 0.02 Hz)*	up to 60 km (15.0 µF at 18 kV <sub>RMS</sub> * 0.02 Hz)*
*at a cable capacitance of approx. 0.25 µF/km						
Max. load at max. output voltage (VLF) and 0.1 Hz		5 µF at 24 kV <sub>RMS</sub>	2.4 µF at 36 kV <sub>RMS</sub>	1.6 µF at 44 kV <sub>RMS</sub>	1.0 µF at 44 kV <sub>RMS</sub>	0.55 µF at 57 kV <sub>RMS</sub>
Discharge - integrated automatic discharge device		max. 9000 J	max. 12500 J	max. 12500 J	max. 12500 J	max. 12500 J
Voltage measuring range		-40...0...40 kV accuracy ±1%	-60...0...60 kV accuracy ±1%	-70...0...70 kV accuracy ±1%	-70...0...70 kV accuracy ±1%	-70...0...70 kV accuracy ±1%
Current measuring ranges		±0...100 µA / 1 mA / 10 mA				
Operating temperature		-20...+45°C				
Storage temperature		-25...+70°C				
Duty		continuous operation				
PC interface		USB stick				
Construction		in two parts: operation unit and high voltage unit				
Dimensions and weight	Operation unit	37 x 34 x 20 cm 17 kg				
	High voltage unit	40 x 41 x 24 cm 38 kg	40 x 44 x 24 cm 48 kg	40 x 44 x 24 cm 49 kg	40 x 44 x 24 cm 49 kg	40 x 44 x 24 cm 49 kg





## Sonel VLF Tester Software

The programme **Sonel VLF Tester Software** generates a test report based on the individual recorded data files.

The first page of the generated report is an overview. The following pages describe the individual tests of the power cable system. The software is easy to use, so you can quickly create a PDF report that is attractive to the end user.

Supported languages: Polish, English, Spanish, German, Czech, Italian. It is possible to generate a report in a language other than the one set for the interface.

BONEL S.A.		www.sonel.pl																																											
Stanisława Wokulskiego 11 58-100 Świdnica, Poland www.sonel.pl • sonel@sonel.pl																																													
<b>Cable Testing Report</b>																																													
Rated Voltage: <input type="checkbox"/> 6/10 kV <input checked="" type="checkbox"/> 10/20 kV <input type="checkbox"/> 18/30 kV		<input checked="" type="checkbox"/> Overall Testing <input type="checkbox"/> Partial Testing																																											
Grid Operator: <b>Division E</b>																																													
Client: <b>Electricity Supply Sonel</b>																																													
Location: <b>Świdnica, Poland</b>																																													
Cable Run: from Station (A) <b>No. 5896, Stanisława Wokulskiego 11</b> to Station (B) <b>No. 5892, Metalowców 30</b>																																													
Cable: <input type="checkbox"/> paper-insulated <input checked="" type="checkbox"/> plastic-insulated <input type="checkbox"/> mixed																																													
Cable Type: <b>NAL3X50/27</b>																																													
Cross Section: <b>3x1x50 mm<sup>2</sup></b>		Cable Length: <b>2410 m</b>																																											
Cause of Cable Testing: <b>Recommissioning</b>																																													
Comment: <b>Cable No. 423</b>																																													
<b>Insulation Testing:</b> <input checked="" type="checkbox"/> from (A) <input type="checkbox"/> from (B)																																													
Desired Values: Method: <input checked="" type="checkbox"/> VLF <input type="checkbox"/> DC		Test Voltage: <b>36 kV</b> Test Time: <b>60 min</b>																																											
<table border="1"><thead><tr><th>Measured Values</th><th>L1-L2-L3-E</th><th>L2-L1-L3-E</th><th>L3-L1-L2-E</th><th>L1-L2-L3-E</th><th>L1-L3-L2-E</th><th>L2-L3-L1-E</th></tr></thead><tbody><tr><td>DC Voltage (kV)</td><td>36.0 kV</td><td>36.0 kV</td><td>36.0 kV</td><td>36.0 kV</td><td>36.0 kV</td><td>36.0 kV</td></tr><tr><td>Frequency (Hz)</td><td>0.1 Hz</td><td>0.1 Hz</td><td>0.1 Hz</td><td>0.1 Hz</td><td>0.1 Hz</td><td>0.1 Hz</td></tr><tr><td>DC Voltage (kV)</td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>Test Time (min)</td><td>60:00 min</td><td>60:00 min</td><td>2:45 min</td><td>2:58 min</td><td></td><td></td></tr><tr><td>Breakdown</td><td>after run</td><td>—</td><td>42.7 kV 37.58 min</td><td>48.8 kV 37.58 min</td><td></td><td></td></tr></tbody></table>				Measured Values	L1-L2-L3-E	L2-L1-L3-E	L3-L1-L2-E	L1-L2-L3-E	L1-L3-L2-E	L2-L3-L1-E	DC Voltage (kV)	36.0 kV	36.0 kV	36.0 kV	36.0 kV	36.0 kV	36.0 kV	Frequency (Hz)	0.1 Hz	0.1 Hz	0.1 Hz	0.1 Hz	0.1 Hz	0.1 Hz	DC Voltage (kV)							Test Time (min)	60:00 min	60:00 min	2:45 min	2:58 min			Breakdown	after run	—	42.7 kV 37.58 min	48.8 kV 37.58 min		
Measured Values	L1-L2-L3-E	L2-L1-L3-E	L3-L1-L2-E	L1-L2-L3-E	L1-L3-L2-E	L2-L3-L1-E																																							
DC Voltage (kV)	36.0 kV	36.0 kV	36.0 kV	36.0 kV	36.0 kV	36.0 kV																																							
Frequency (Hz)	0.1 Hz	0.1 Hz	0.1 Hz	0.1 Hz	0.1 Hz	0.1 Hz																																							
DC Voltage (kV)																																													
Test Time (min)	60:00 min	60:00 min	2:45 min	2:58 min																																									
Breakdown	after run	—	42.7 kV 37.58 min	48.8 kV 37.58 min																																									
<b>Sheath Testing:</b> <input checked="" type="checkbox"/> from (A) <input type="checkbox"/> from (B)																																													
<table border="1"><thead><tr><th>Measured Values</th><th>S<sub>1</sub>→E</th><th>S<sub>2</sub>→E</th><th>S<sub>3</sub>→E</th><th>S<sub>4</sub>→E</th><th>Desired Values:</th></tr></thead><tbody><tr><td>DC Voltage (kV)</td><td></td><td></td><td></td><td></td><td>Test Voltage (DC):</td></tr><tr><td>Test Time (min)</td><td></td><td></td><td></td><td></td><td>Test Time:</td></tr><tr><td>Breakdown</td><td>yes/no</td><td></td><td></td><td></td><td></td></tr></tbody></table>				Measured Values	S <sub>1</sub> →E	S <sub>2</sub> →E	S <sub>3</sub> →E	S <sub>4</sub> →E	Desired Values:	DC Voltage (kV)					Test Voltage (DC):	Test Time (min)					Test Time:	Breakdown	yes/no																						
Measured Values	S <sub>1</sub> →E	S <sub>2</sub> →E	S <sub>3</sub> →E	S <sub>4</sub> →E	Desired Values:																																								
DC Voltage (kV)					Test Voltage (DC):																																								
Test Time (min)					Test Time:																																								
Breakdown	yes/no																																												
<b>Test Results:</b> <b>Fault occurred!</b>																																													
Comments to the Test: <b>Insulation Fault on L3, Repair or Replacement</b>																																													
Date: <b>30.11.2023</b> Client: <b>Mr. Miller</b>		Tester: <b>Mr. Haugke</b>																																											
Report No.: <b>0182</b>		Page 1/5																																											

## Standard accessories



High voltage  
connecting cable  
(shielded) 5 m

Bridging cables



Connecting cable  
between high  
voltage unit and  
station ground



Connecting cable  
between operation  
unit and protec-  
tive ground



Service pack

Start keys



Case

WAWALVLF



User manual

## Optional accessories



USB stick for data  
logging

WAADAHVVFLDL



Case with wheels

WAWALVLF2



Sonel VLF Tester  
Software

WAPROVLFTS



Frequency extension  
0.05 Hz + 0.02 Hz

WAADAHVVLFPE